Enclosure, EN-7010X, Digital ASC for AHU-1 and AHU-2

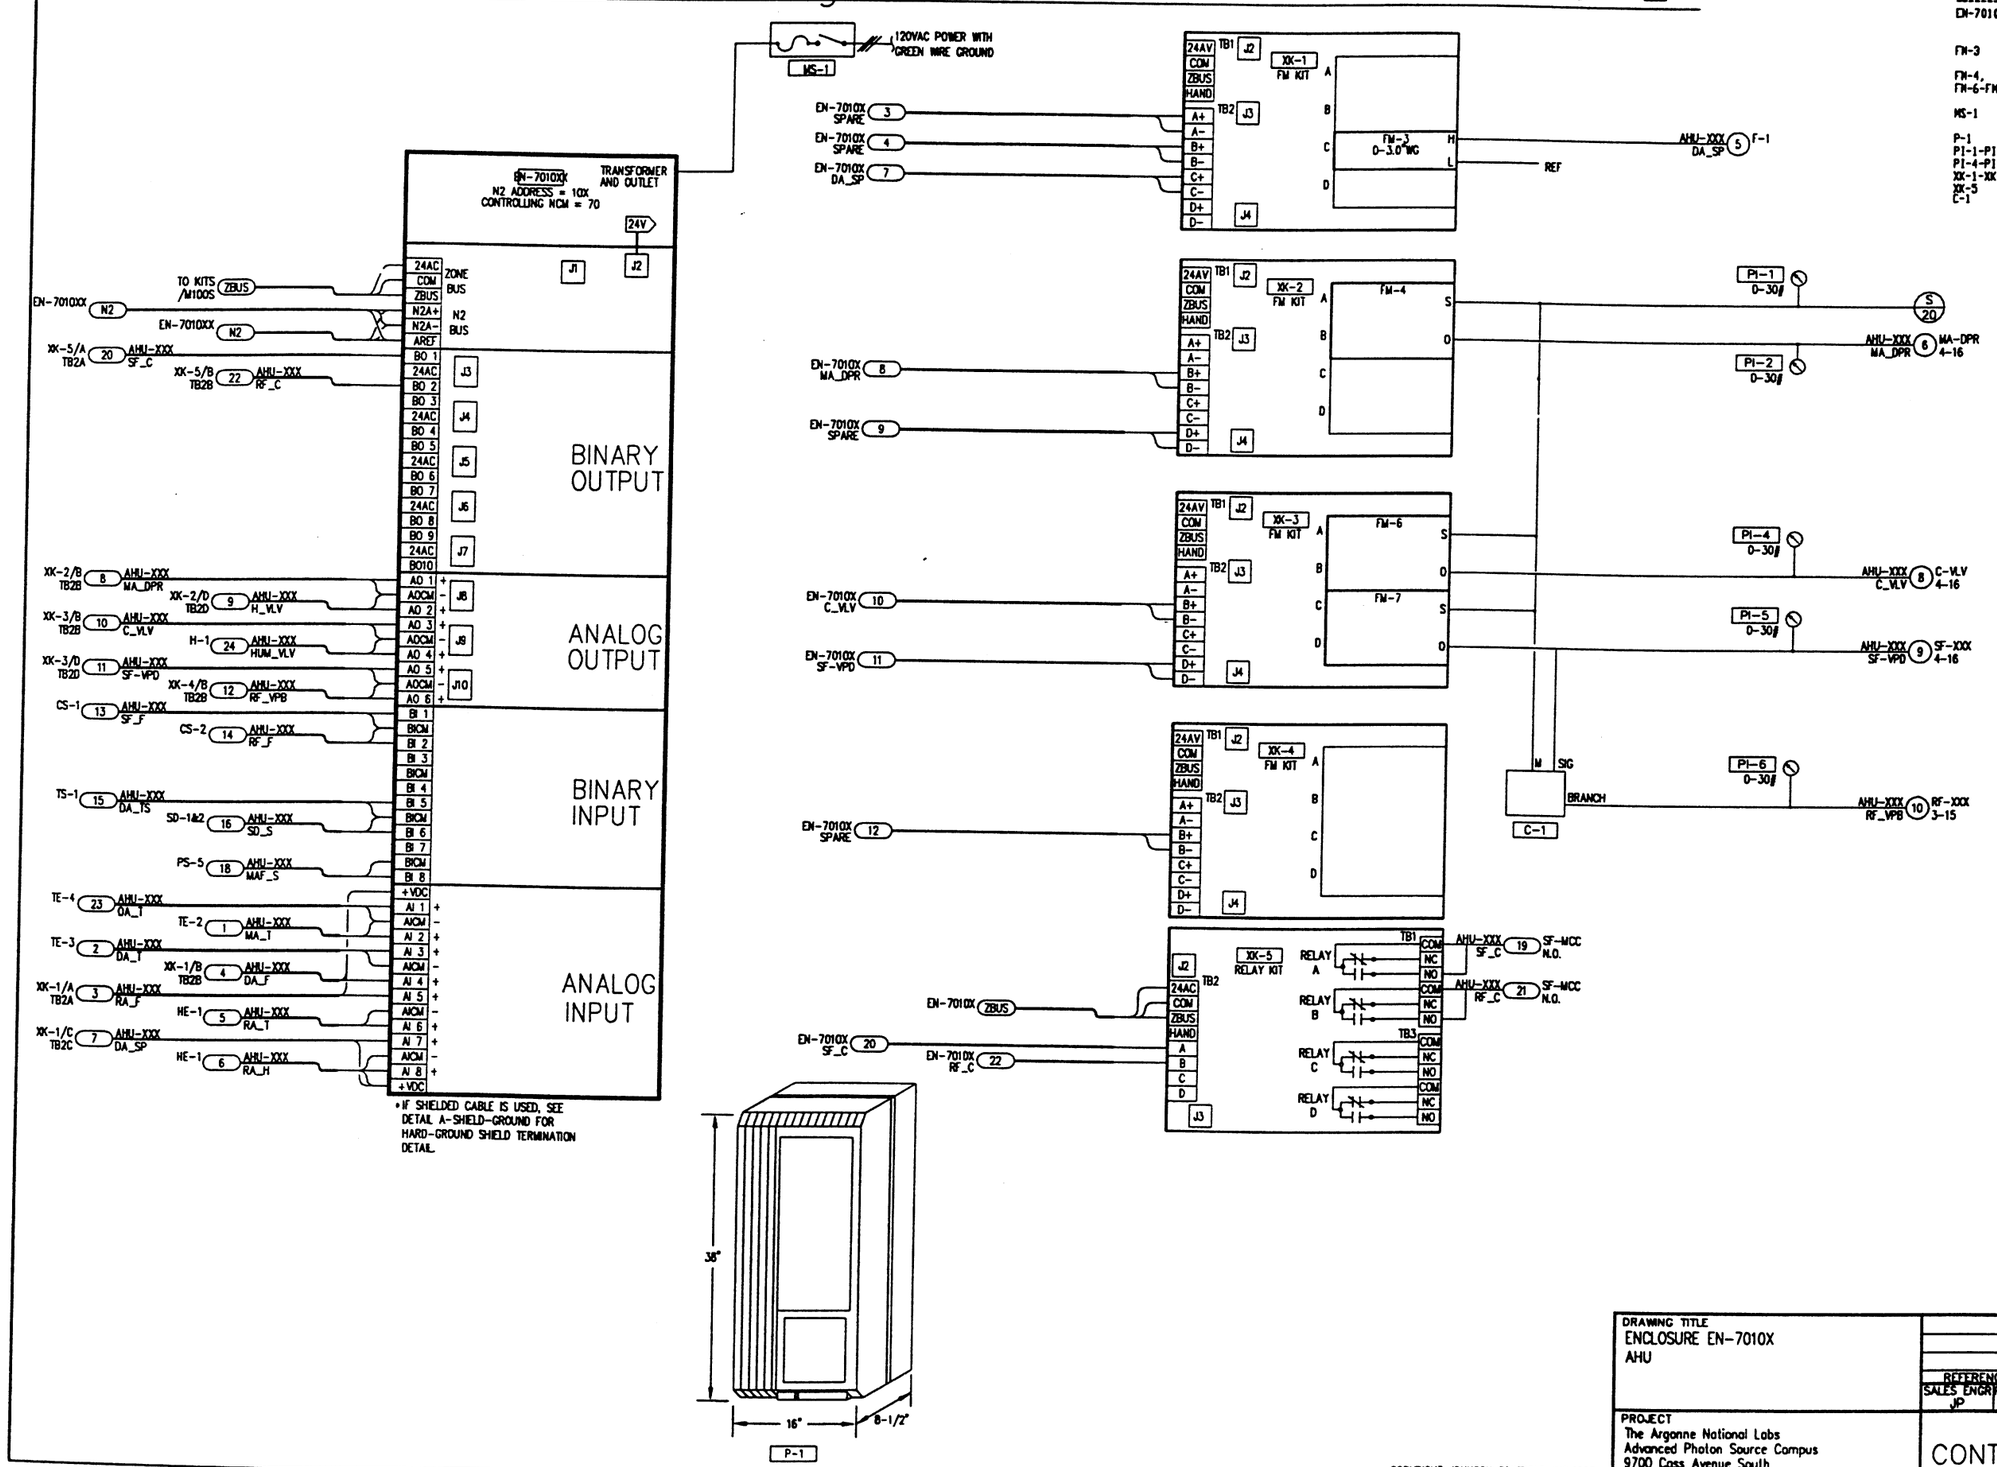

PANEL MATERIAL

DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
EN-7010XX	2	AS-AHU101-0	AIR HANDLING UNIT ENC/TER
	2	AS-AHU102-0	AIR HANDLING UNIT LOGIC B
	2	AS-XFR100-1	TRANSFORMER KIT;120/240
FM-3	1	FM-IDP030-0	DIFF PRESS; INPUT 0/3.00"
	1	FM-PCM101-0	PNEU.CONN.MOD.
FM-4, FM-6-FM-7	3	FM-DAP102-0	DAP MANUAL MODULE
	3	FM-DAP103-0	E/P OUT FM FOR ASC
MS-1	1	PD-112-22	BUSS SSU FUSE HOLDER/
	1	PD-112-23	FUSE T-5 (5AMP) FOR
P-1	1	EN-EVC200-0	NCU/NEU 16X30 ENCLOSURE
PI-1-PI-2, PI-4-PI-6	5	G-2010-101	GAGE 2" 0-300/0-200KPA
XK-1-XK-4	4	AS-FMK100-0	FUNCTION MOD KIT-4 SLOTS
XK-5	1	AS-RLY100-0	
C-1	2	KRN-1010	RATIO RELAY-DYNACON

RECEIVED
OCT 07 1994
PERINI BLDG. CO., INC.
OB #003 - ARGONNE NATL. LAB

FILE: EN-7010

DRAWING TITLE
ENCLOSURE EN-7010X
AHU

REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
	1	GENERAL		09/27/94	SF

SALES ENGR	PROJECT MGR	APPL. ENGR	DRAWN	APPROVED
JP	SF	DCS	BY DCS DATE 12/12/93	BY DATE

PROJECT
The Argonne National Labs
Advanced Photon Source Campus
9700 Cass Avenue South
Argonne, IL 60439

JOHNSON CONTROLS
Systems & Services Division

3007 MALMO ROAD
ARLINGTON HEIGHTS
ILLINOIS 60005
708/364-1500 Main
708/806-4438 Eng

CONTRACT NUMBER 91390-0009
DRAWING NUMBER 91-9-G-01B

COPYRIGHT JOHNSON CONTROLS, INC. 1993