Enclosure, EN-01101, Digital ASC for AHU-801

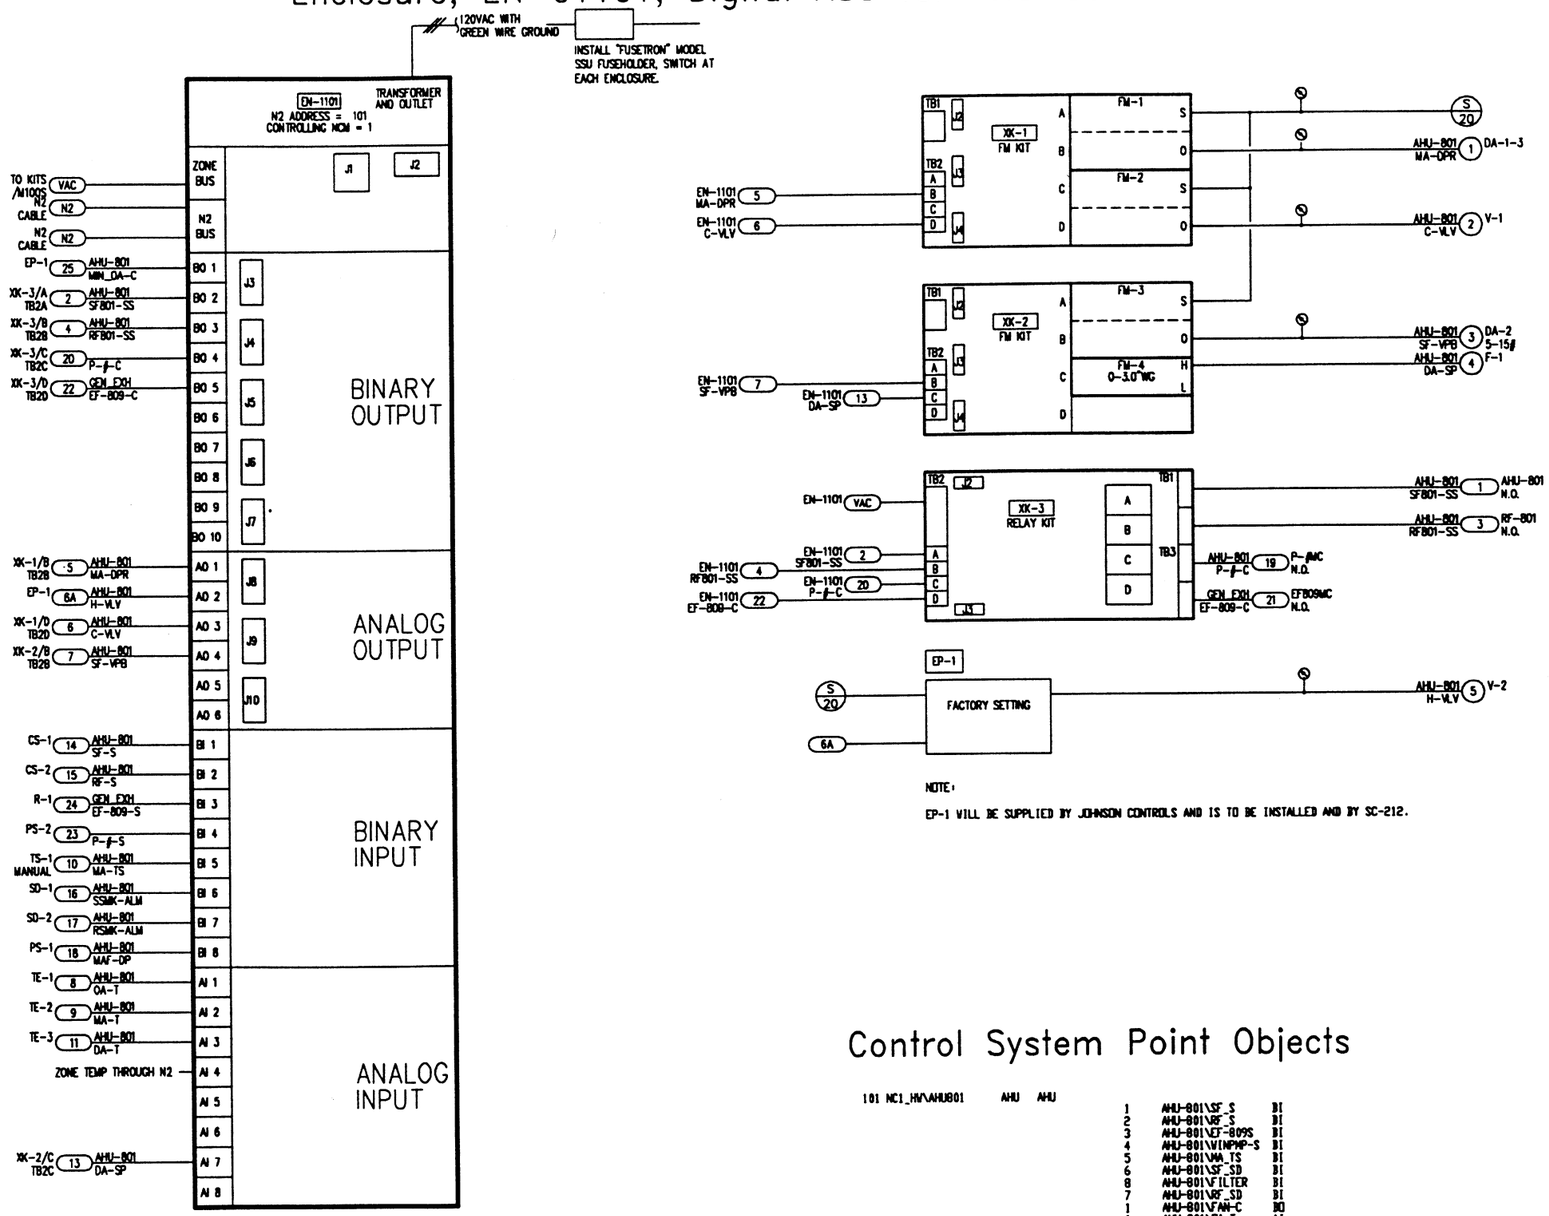

NOTE:

EP-1 WILL BE SUPPLIED BY JOHNSON CONTROLS AND IS TO BE INSTALLED AND BY SC-212.

PANEL MATERIAL

DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
(P) EN-1101	1	AS-AHU101-0	AIR HANDLING UNIT ENC/TER
	1	AS-AHU102-0	AIR HANDLING UNIT LOGIC B
	1	AS-XFR100-0	100VA TRANSFORMER KIT
	1	EN-EVC200-0	ENCLOSURE
(P) FM-1-FM-3	3	FM-DAP102-0	DAP MANUAL MODULE
	3	FM-DAP103-0	E/P OUT FM FOR ASC
(P) FM-4	1	FM-IDP030-0	DIFF PRESS INPUT FM 3. IN
	1	FM-PCM101-0	PNEU.CONN.MOD.
(P) XX-1-XX-2	2	AS-FMK100-0	FUNCTION MOD KIT-4 SLOTS
(P) XX-3	1	AS-RLY100-0	LINE VOLTAGE RELAY KIT
(P) ACC	4	G-2010-5	0-30 PSI, 1 1/2 INCH PRESSURE GAUGE
(P) ACC	1	G-2010-5	0-30 PSI, 1 1/2 INCH PRESSURE GAUGE
(P) EP-1	1	EP-8000-4	4-20 ma/0-20 PSIG TRANDUCER

NOTES:

1. ALL MATERIAL WITH (P) PRECEEDING THE DEVICE TAG IN THE BILL OF MATERIAL IS PROPRIETARY AND IS BEING SUPPLIED BY JOHNSON CONTROLS, INC. ALL OTHER MATERIAL IS NON-PROPRIETARY.

Control System Point Objects

101 NC1_HV\AHU801 AHU AHU

1	AHU-801\SF_S	BI
2	AHU-801\RF_S	BI
3	AHU-801\EF-809S	BI
4	AHU-801\WINPMP-S	BI
5	AHU-801\MA_TS	BI
6	AHU-801\SF_SD	BI
8	AHU-801\FILTER	BI
7	AHU-801\RF_SD	BI
1	AHU-801\FAN-C	BO
1	AHU-801\OA_T	AI
2	AHU-801\MA_T	AI
3	AHU-801\DA_T	AI
7	AHU-801\STATIC	AI

COPYRIGHT JOHNSON CONTROLS, INC.1993

FILE: EN-1101

REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		RECORD		05/11/94	SF
	3	ADD HEATING COIL		01/04/93	SF
	2	ADD DISCONNECT		07/16/92	SF

DRAWING TITLE
Air Handling Unit, AHU-801
Enclosure, EN-01101
Mixed Air Single Path,
Contstant Volume

SALES ENGR	PROJECT MGR	APPL. ENGR	DRAWN	APPROVED
JP	SF	DCS	BY SF DATE 03/27/92	BY DATE

PROJECT
The Argonne National Labs
Advanced Photon Source Campus
9700 Cass Avenue South
Argonne, IL 60439

JOHNSON CONTROLS
Systems & Services Division

3007 MALMO ROAD
ARLINGTON HEIGHTS
ILLINOIS 60005
708/364-1500 Main
708/808-4438 Eng

CONTRACT NUMBER 91390-0009

DRAWING NUMBER 91-9-A-04B